




ASTM C 1202-97



Test-compagny
Testing street 45
CompagnyCity
Some Country

Your own logo.
size=20x80mm




GERMANN INSTRUMENTS

DENMARK
Phone: +45 3967 7117
Fax: +45 3967 3167

USA
Phone: (847)329-9999
Fax: (847)329-8888

Test report

Voltage Used: 60
 Testing time: 06:00 hour
 Charge passed: 4899
 Adjusted Charge passed: 4421
 Permeability class: High
 Instrument number: 072707
 Channel number: 1
 Report date: 25/04/2014
 Testing by: ---
 Reference: ---
 Sample diameter: 100
 Comment: ---

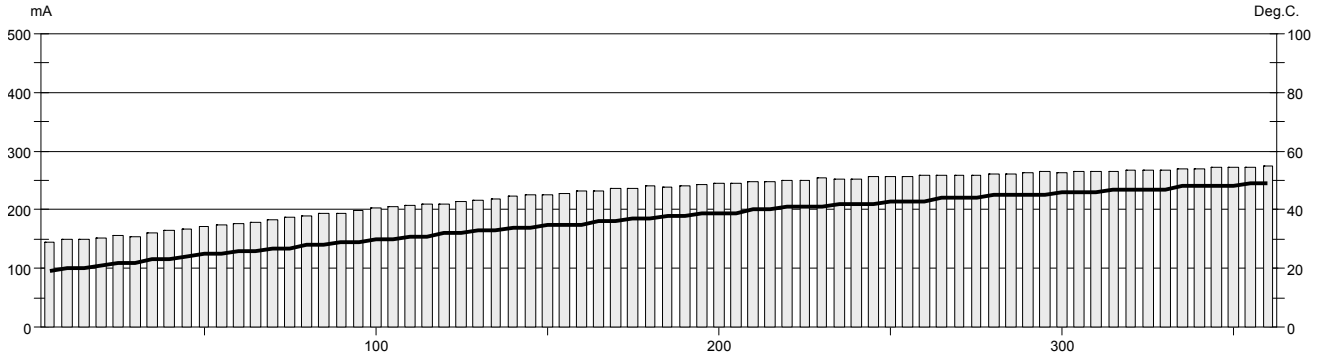

Time	°C	mA	Time	°C	mA	Time	°C	mA	Time	°C	mA
00:05	19	145.9	01:35	29	197.6	03:05	38	238.6	04:35	44	259.7
00:10	20	149.3	01:40	30	202.4	03:10	38	242.1	04:40	45	260.7
00:15	20	150.1	01:45	30	205.5	03:15	39	243.6	04:45	45	261.3
00:20	21	150.8	01:50	31	207.7	03:20	39	246.0	04:50	45	263.3
00:25	22	156.3	01:55	31	209.2	03:25	39	246.3	04:55	45	265.2
00:30	22	155.0	02:00	32	210.4	03:30	40	246.7	05:00	46	264.0
00:35	23	160.1	02:05	32	213.8	03:35	40	248.5	05:05	46	264.6
00:40	23	165.6	02:10	33	215.6	03:40	41	249.1	05:10	46	264.9
00:45	24	167.2	02:15	33	219.8	03:45	41	249.5	05:15	47	265.6
00:50	25	171.8	02:20	34	223.9	03:50	41	253.4	05:20	47	266.8
00:55	25	174.7	02:25	34	226.4	03:55	42	252.1	05:25	47	267.4
01:00	26	175.8	02:30	35	226.4	04:00	42	253.2	05:30	47	268.6
01:05	26	178.4	02:35	35	228.7	04:05	42	256.2	05:35	48	269.3
01:10	27	182.3	02:40	35	232.7	04:10	43	256.3	05:40	48	271.1
01:15	27	186.4	02:45	36	231.8	04:15	43	256.2	05:45	48	271.7
01:20	28	189.4	02:50	36	235.7	04:20	43	259.0	05:50	48	273.1
01:25	28	193.6	02:55	37	237.0	04:25	44	258.7	05:55	49	273.0
01:30	29	193.9	03:00	37	240.2	04:30	44	258.7	06:00	49	274.9